

**GROUND POLE VALVE
BOX INSTALLATION
DETAIL**


SUPPLIED FAN POLE

NOTE:
- ALL CONCRETE DIMENSIONS ARE MINIMAL

VALVE BOX
(OPTIONAL)

CUSTOMER TO PROVIDE SUPPLY POWER
WIRING, CONDUIT W/ LIQUID TIGHT FITTING
(RECOMMENDED IF CONDUIT USED),
INSTALLATION/ASSEMBLY, & CONCRETE (MIN
422LB OF CONCRETE IF HOLE AS
DIMENSIONED HERE)

MAX. 1" BETWEEN
PLATE AND CONCRETE

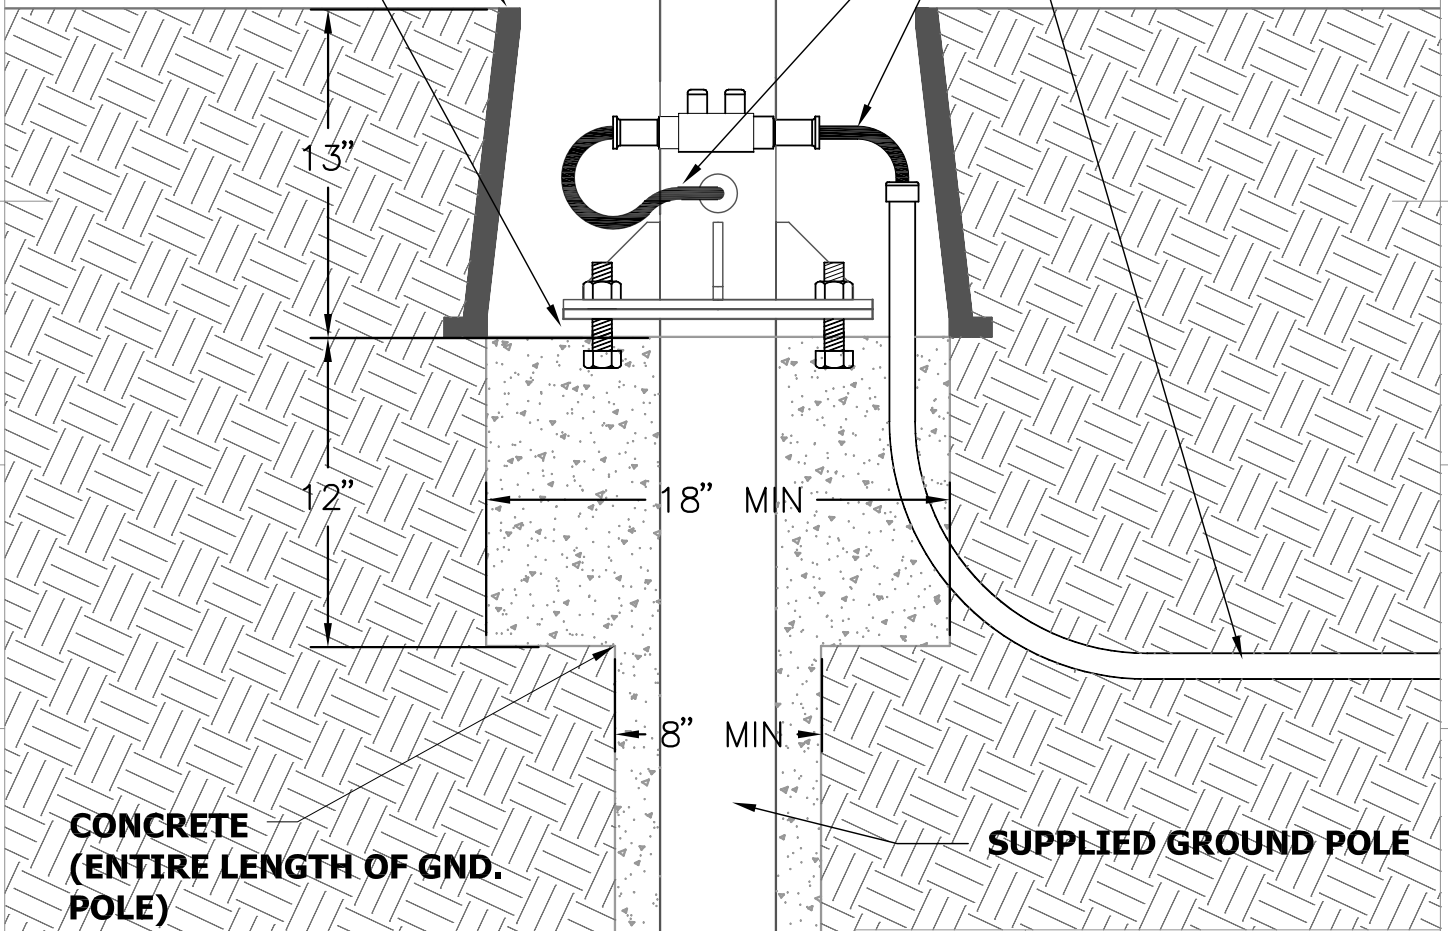

**CONCRETE
(ENTIRE LENGTH OF GND.
POLE)**

SUPPLIED GROUND POLE

DRAWN BY: H. MURPHY
DATE: 2/27/07
REVISED BY: H.MURPHY
DATE: 6/4/07
PRIMARY UNITS: -----
SCALE: N/A
QTY REQ: (X)
MAT'L: -----
FINISH: -----

UNLESS OTHERWISE
SPECIFIED MAXIMUM
TOLERANCES ARE:

FRACTIONAL
± 1/8

DECIMAL
.XX ± .01
.XXX ± .005



SubAir

510 Bettis Academy Rd
Graniteville, SC 29829
(803) 641-6663

Title: FAN POLE SPECIFICATIONS
--VLV. BOX INST. DETAIL

Dwg No. ###